

2019-01-15 18:06:39



IR_1383.jpg

FLIR B660

404002896

Measurements


Sp1	-2.9 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:06:59

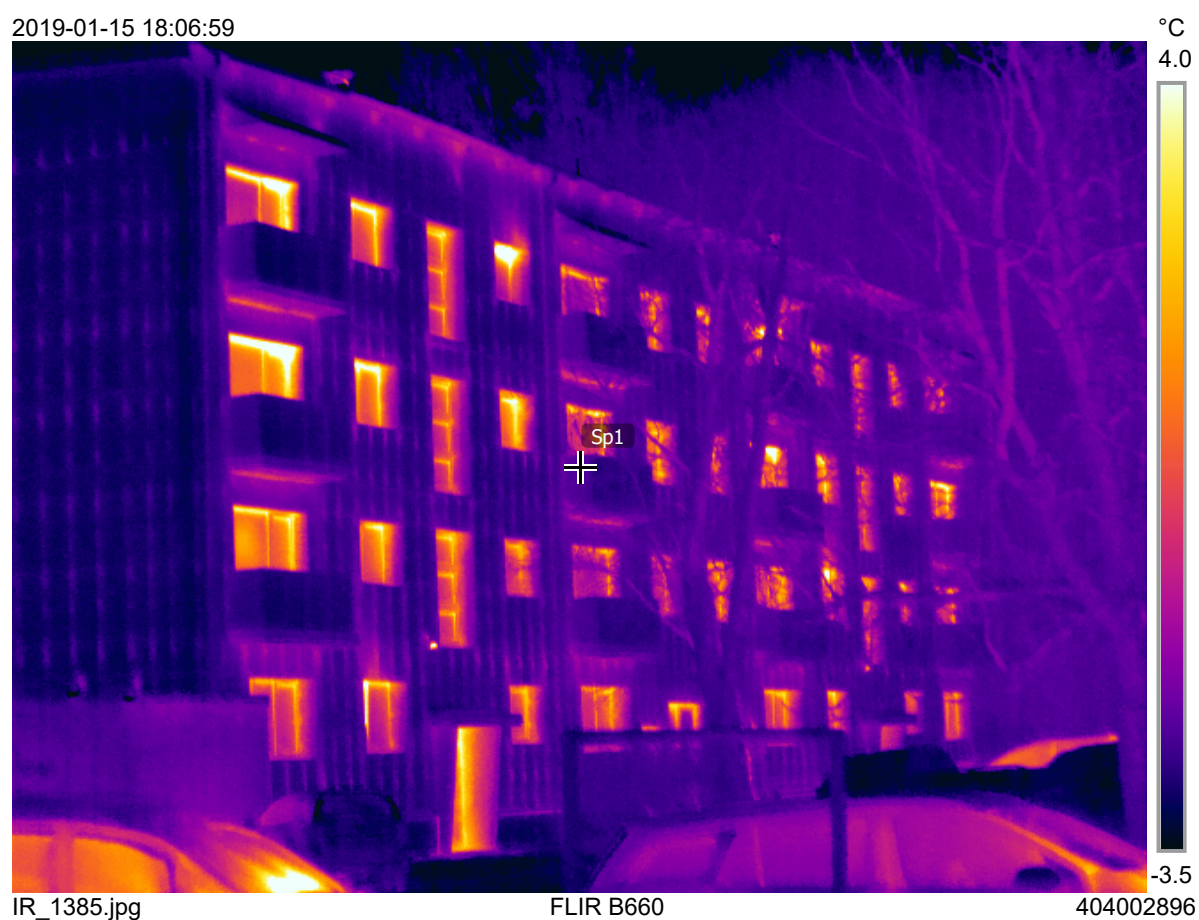

Measurements

Sp1	-2.3 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:07:25



IR_1387.jpg

FLIR B660

404002896

Measurements


Sp1	-1.6 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:07:45

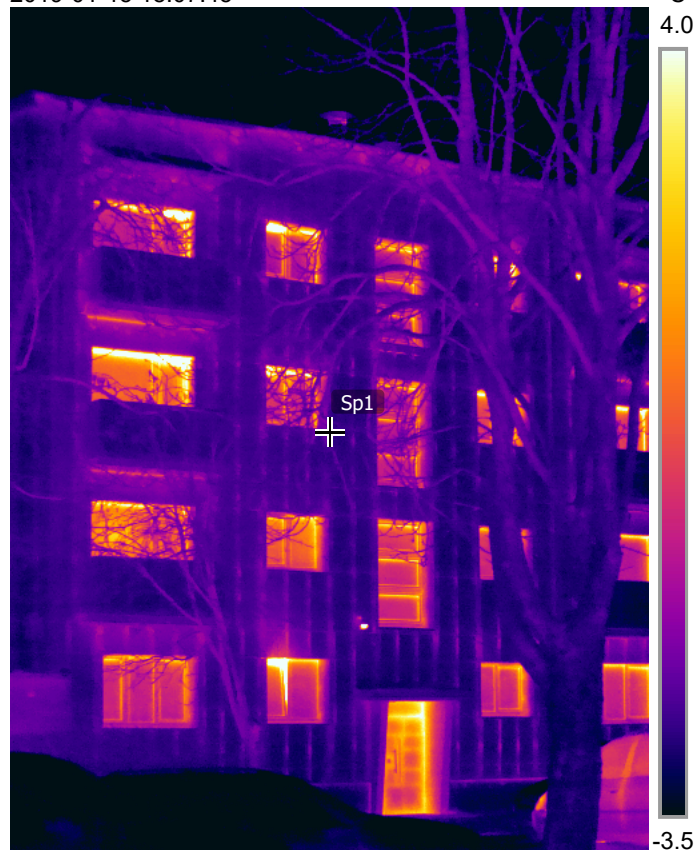

IR_1389.jpg

FLIR B660

404002896

Measurements


Sp1	-2.0 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:08:41

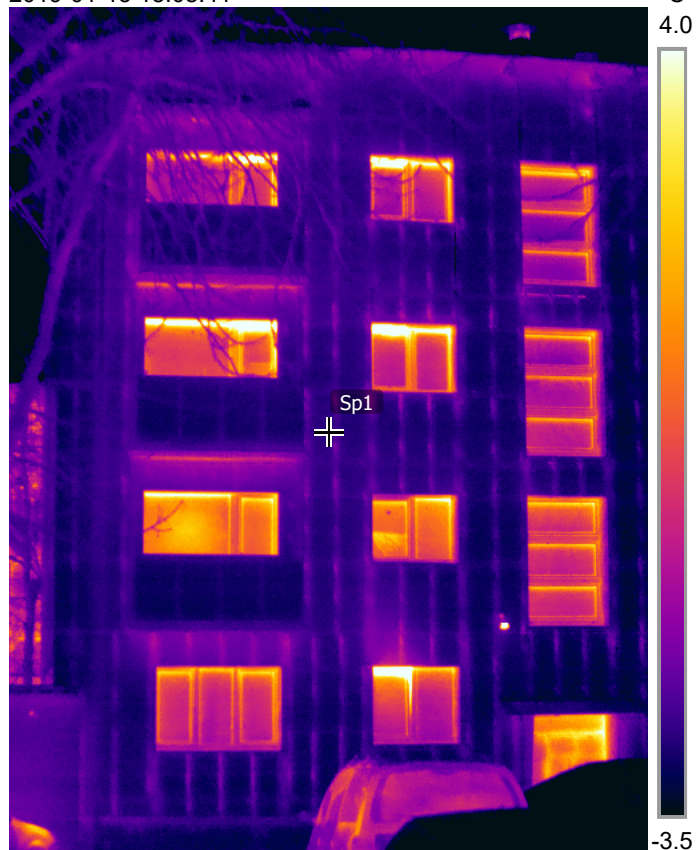

IR_1391.jpg

FLIR B660

404002896

Measurements

Sp1	-2.7 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:09:29



IR_1393.jpg

FLIR B660

404002896

Measurements


Sp1	-2.9 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:09:45

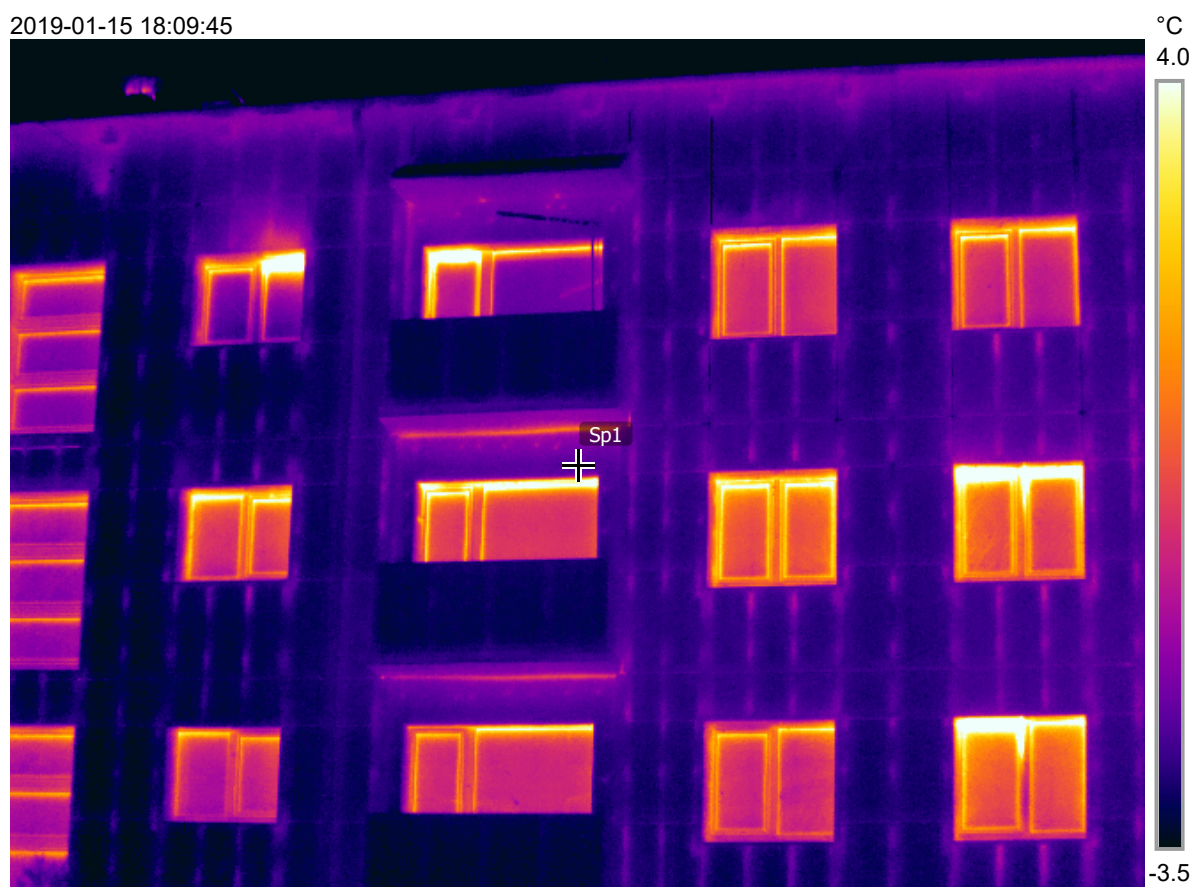

IR_1395.jpg

FLIR B660

404002896

Measurements

Sp1	-2.3 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:10:15



IR_1397.jpg

FLIR B660

404002896

Measurements


Sp1	-2.7 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:10:32

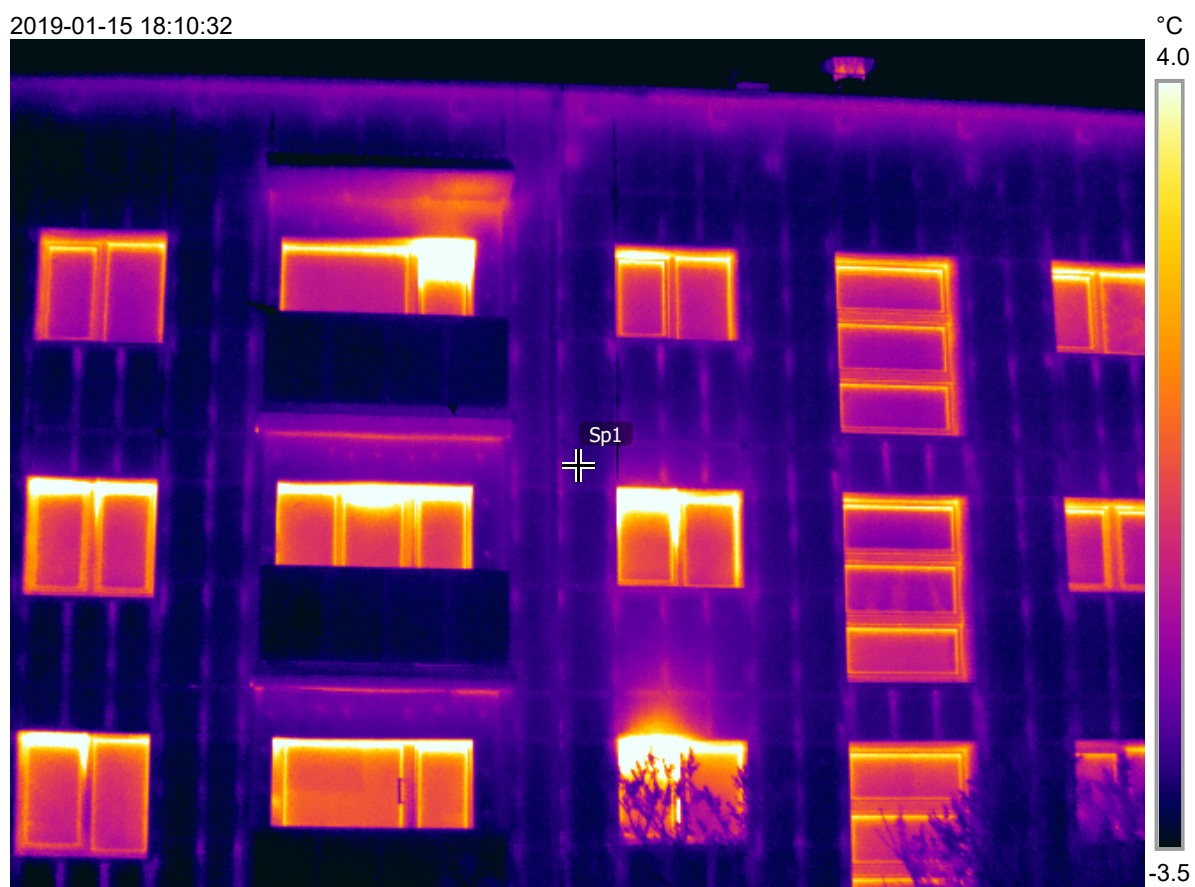

IR_1399.jpg

FLIR B660

404002896

Measurements


Sp1	-2.6 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:10:50

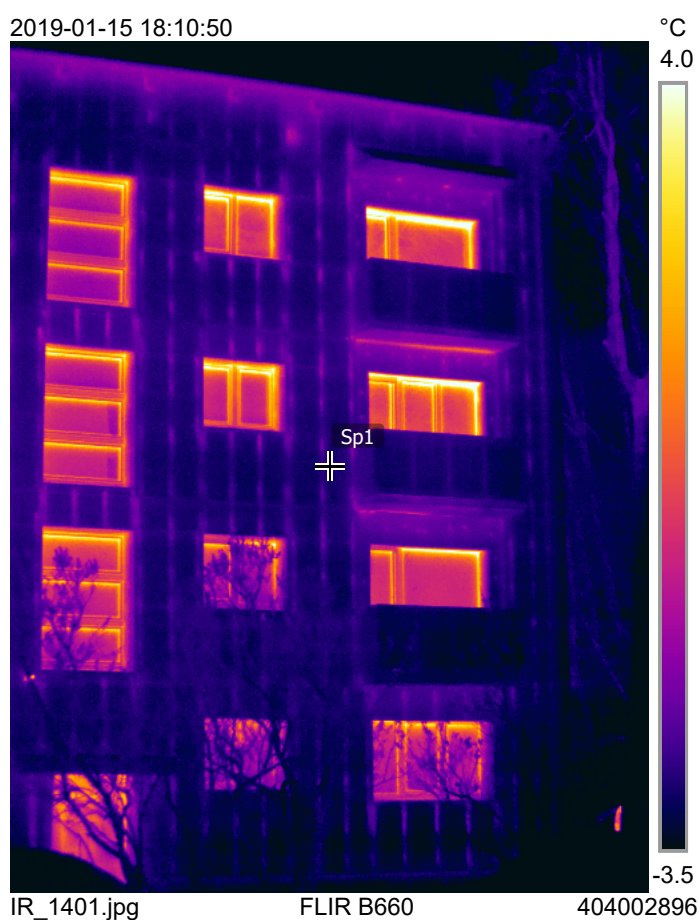

IR_1401.jpg

FLIR B660

404002896

Measurements


Sp1	-2.9 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:11:36

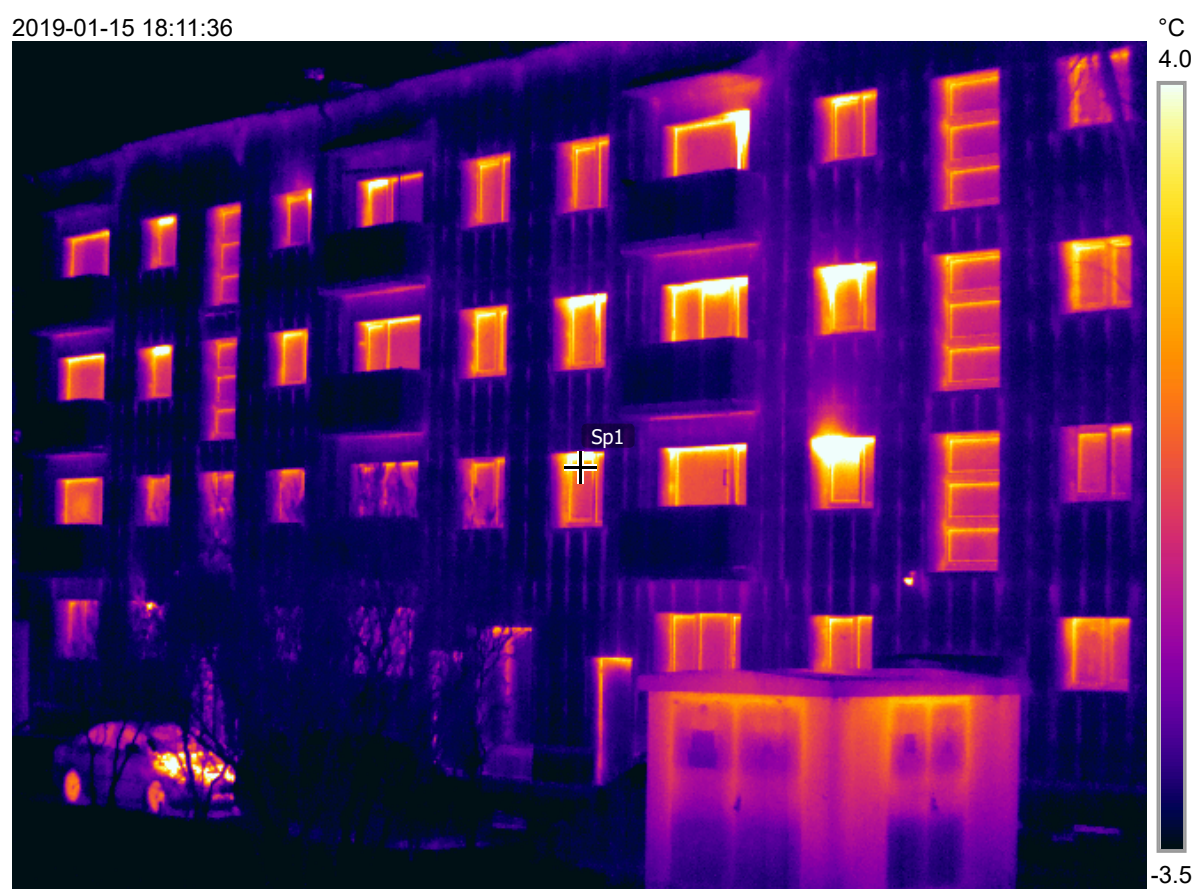

IR_1403.jpg

FLIR B660

404002896

Measurements


Sp1	1.0 °C
-----	--------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:12:16

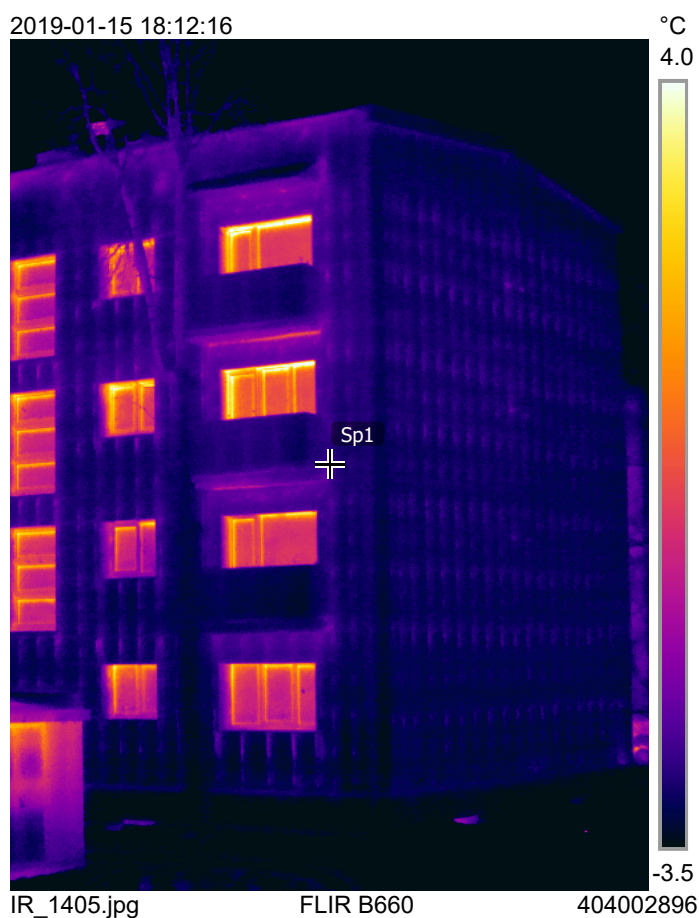

Measurements


Sp1	-2.3 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:13:33

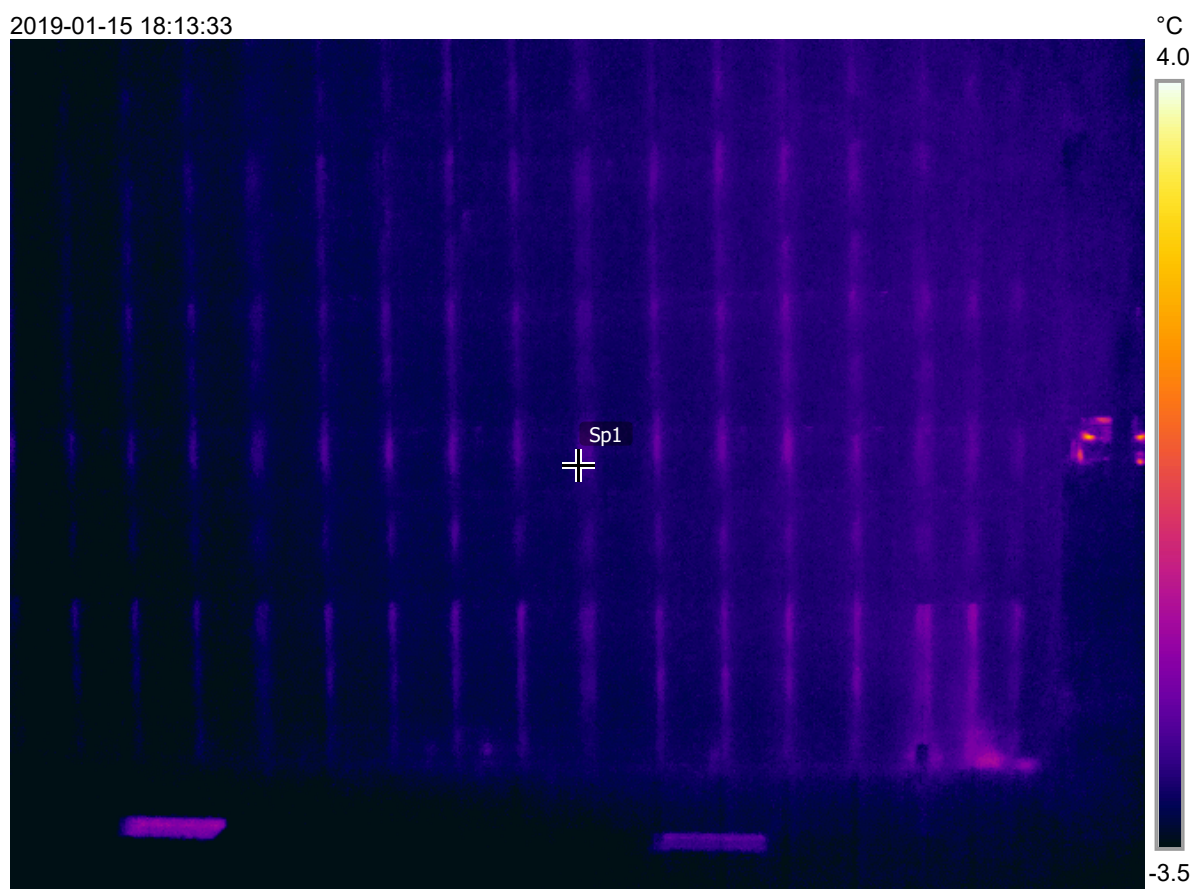

IR_1407.jpg

FLIR B660

404002896

Measurements


Sp1	-2.8 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:13:50

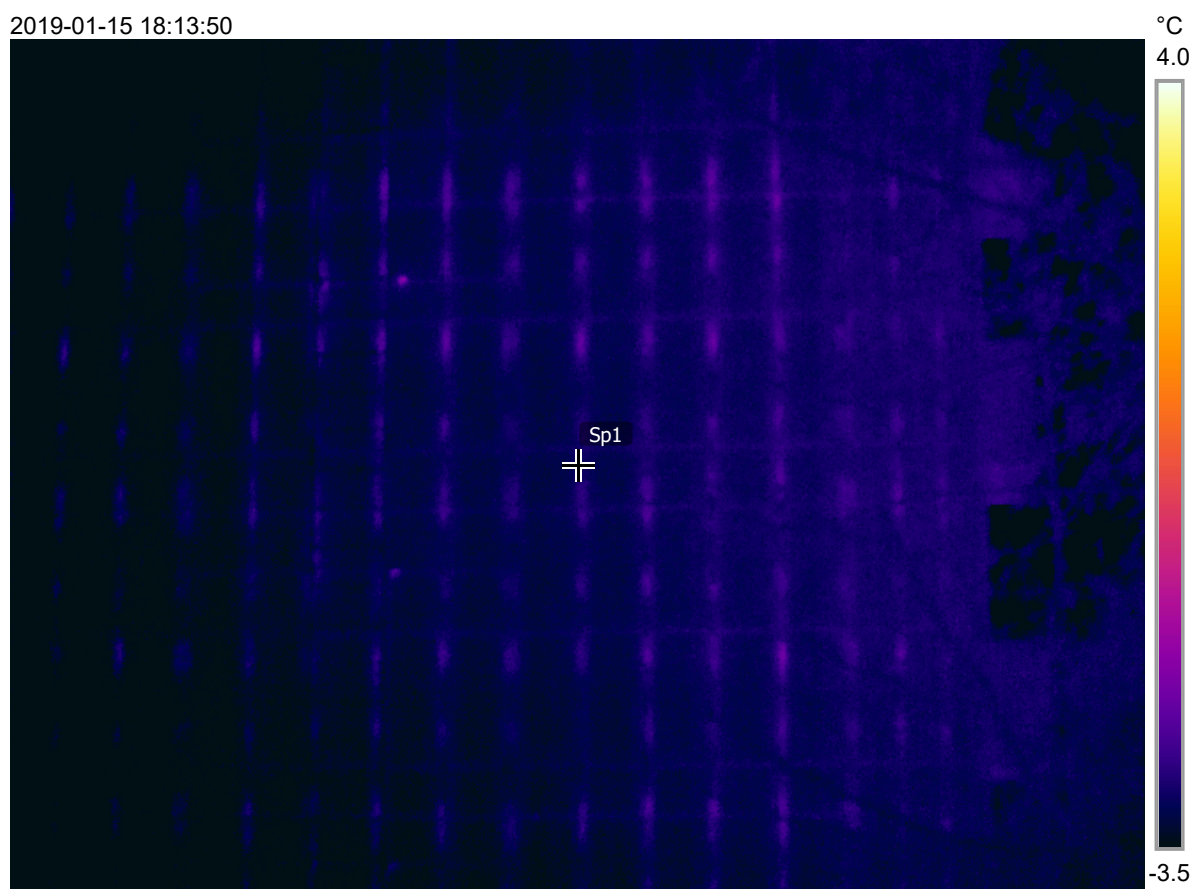

IR_1409.jpg

FLIR B660

404002896

Measurements


Sp1	-3.0 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:14:08

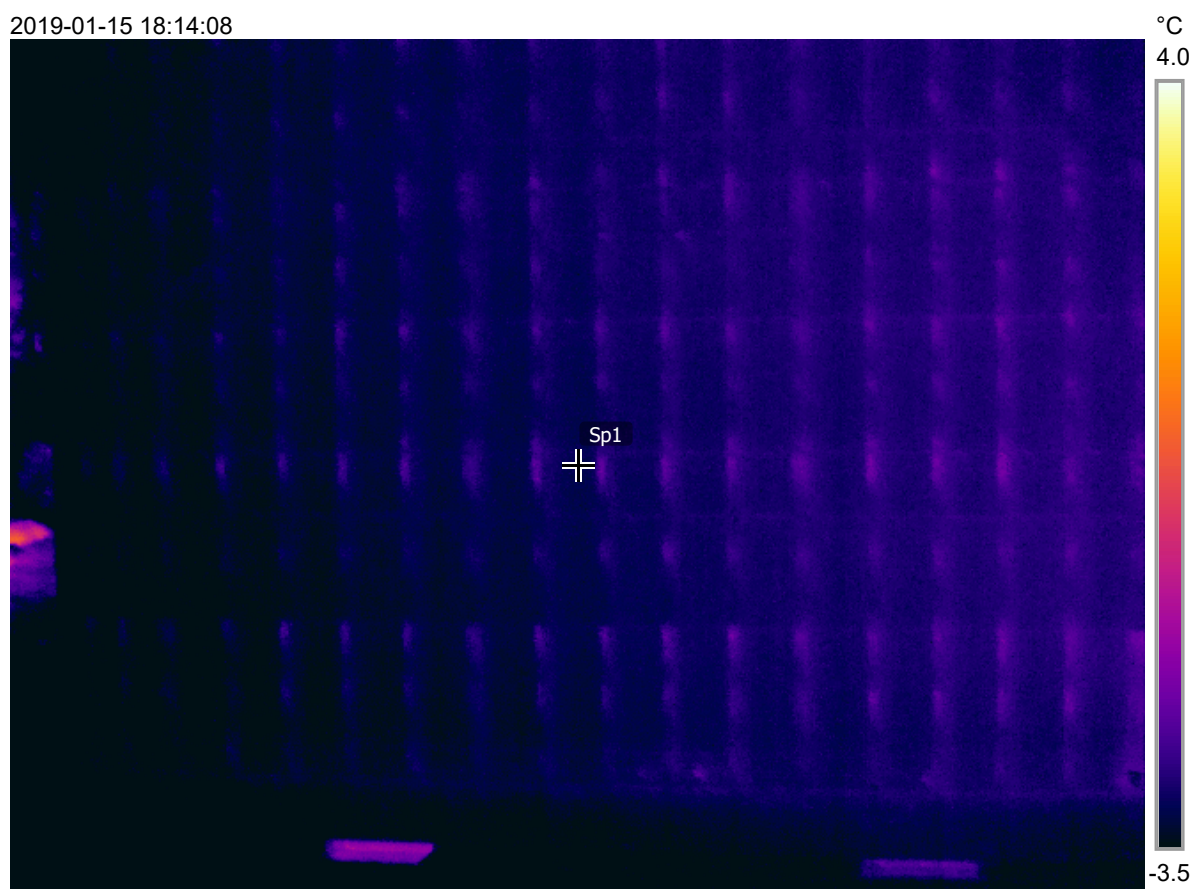

IR_1411.jpg

FLIR B660

404002896

Measurements


Sp1	-3.0 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:14:23

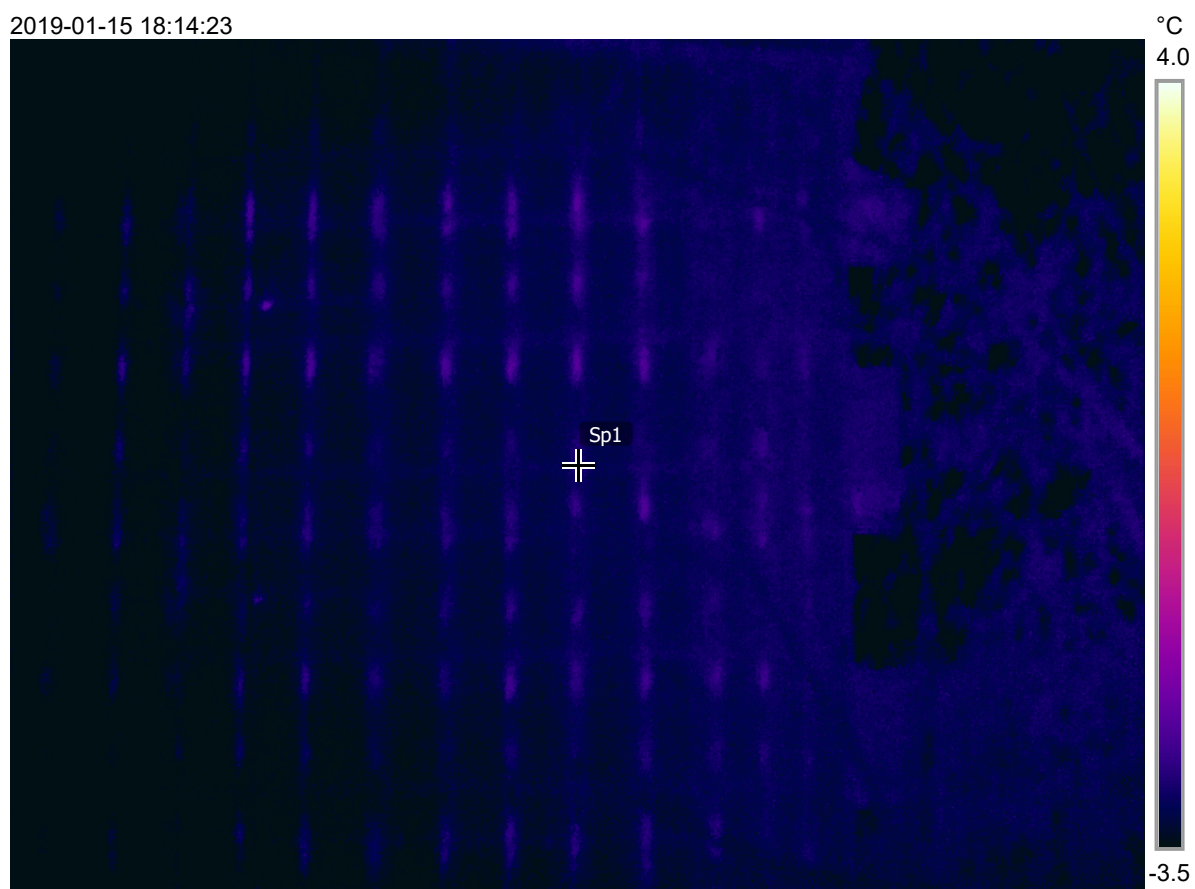

IR_1413.jpg

FLIR B660

404002896

Measurements


Sp1	-2.9 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:15:31

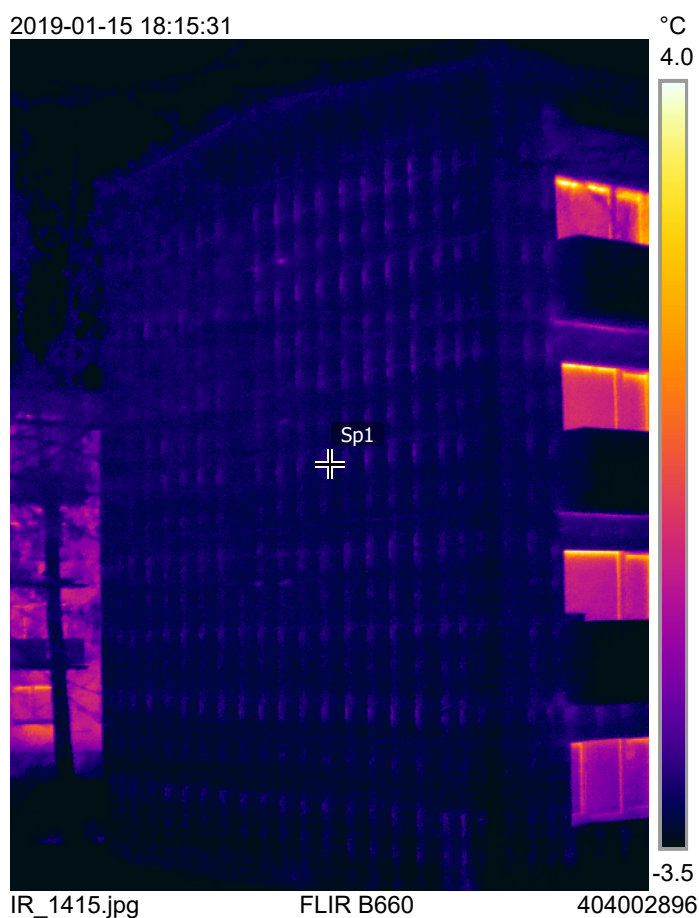

Measurements


Sp1	-3.1 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:15:50

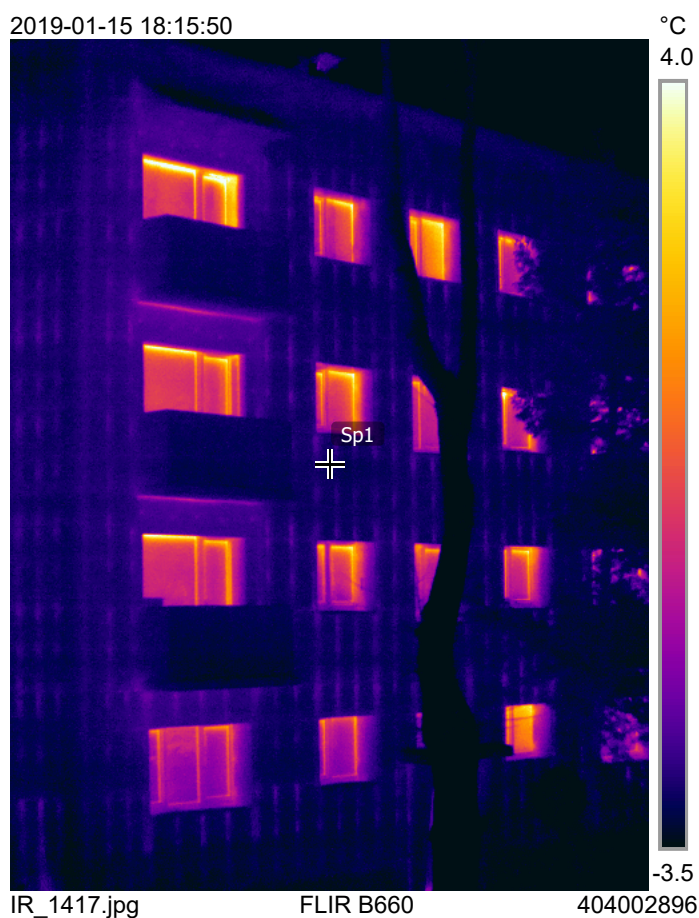

IR_1417.jpg

FLIR B660

404002896

Measurements

Sp1	-3.0 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:16:07



IR_1419.jpg

FLIR B660

404002896

Measurements


Sp1	1.1 °C
-----	--------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:16:40

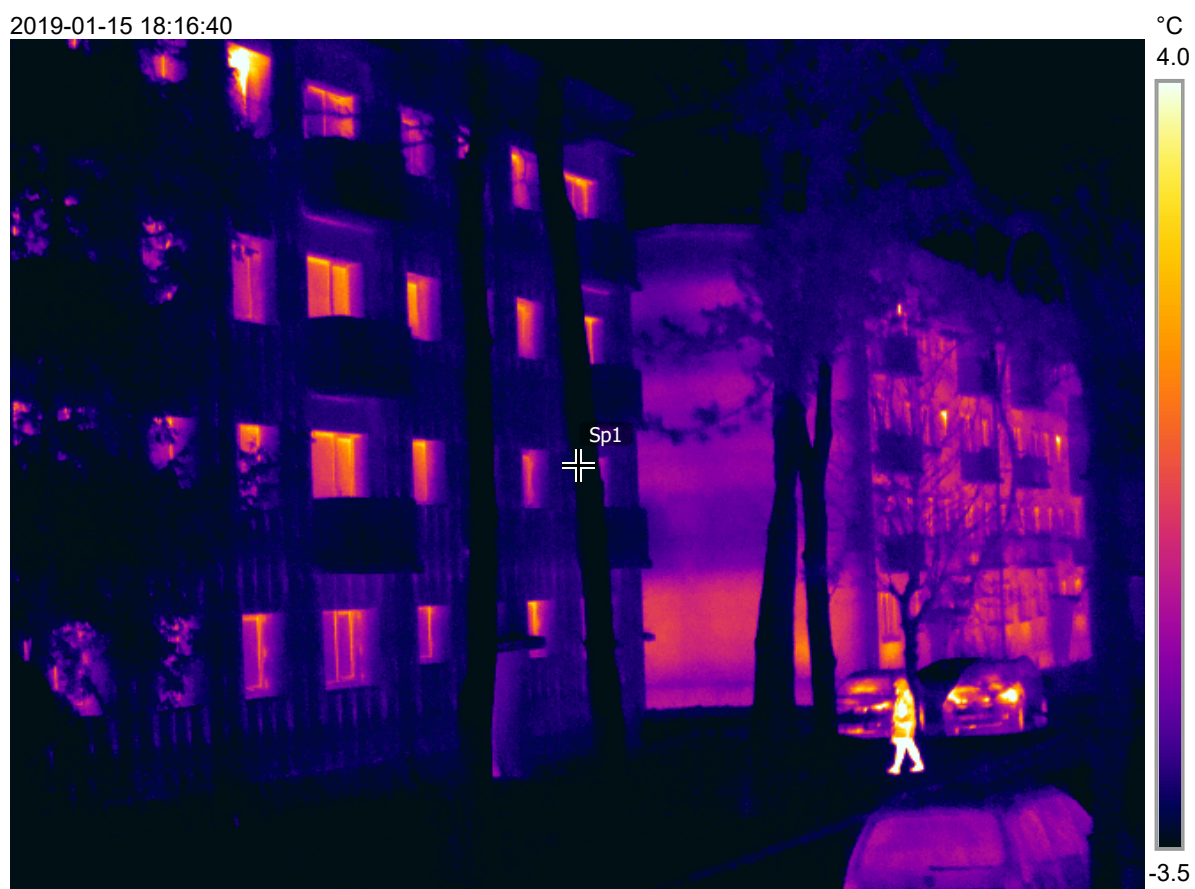

IR_1421.jpg

FLIR B660

404002896

Measurements

Sp1	-3.5 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:17:35



IR_1423.jpg

FLIR B660

404002896

Measurements


Sp1	-3.5 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:17:54

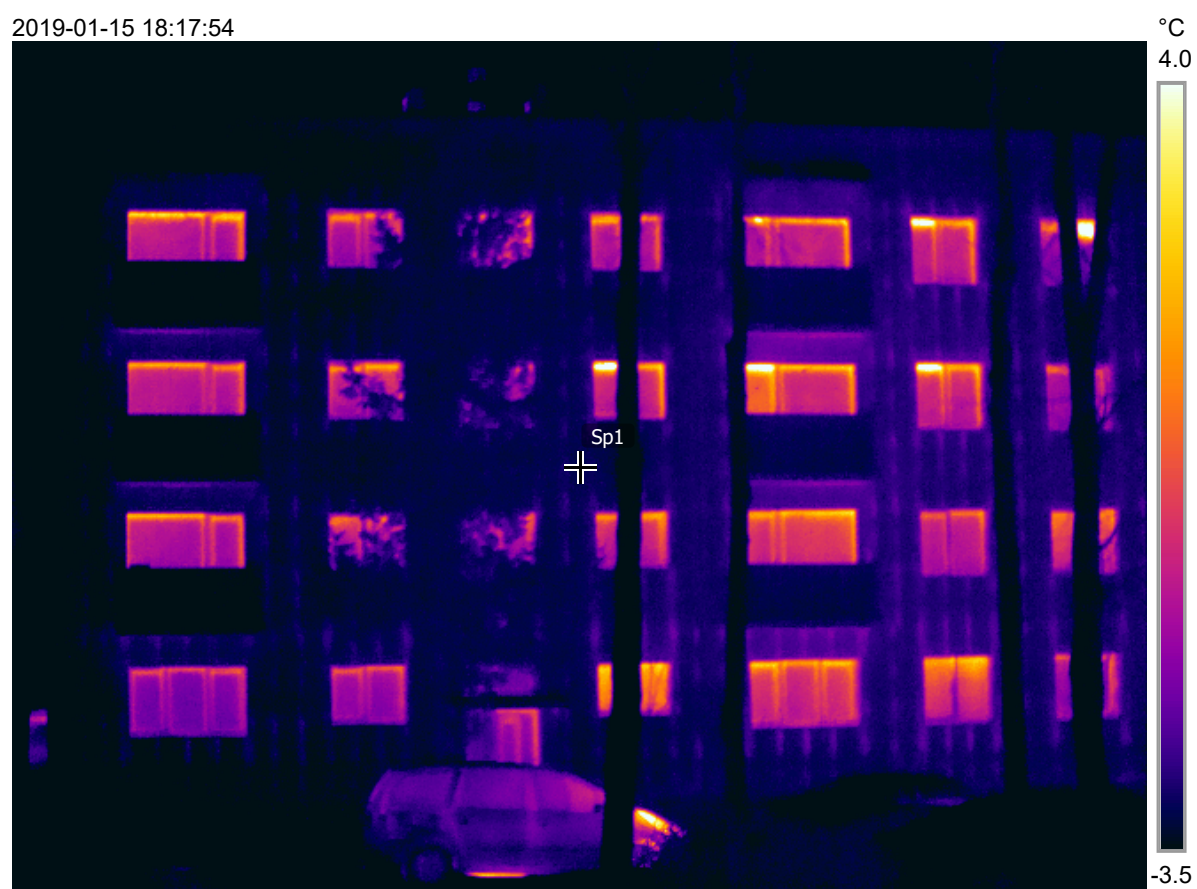

IR_1425.jpg

FLIR B660

404002896

Measurements


Sp1	-3.0 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:19:33

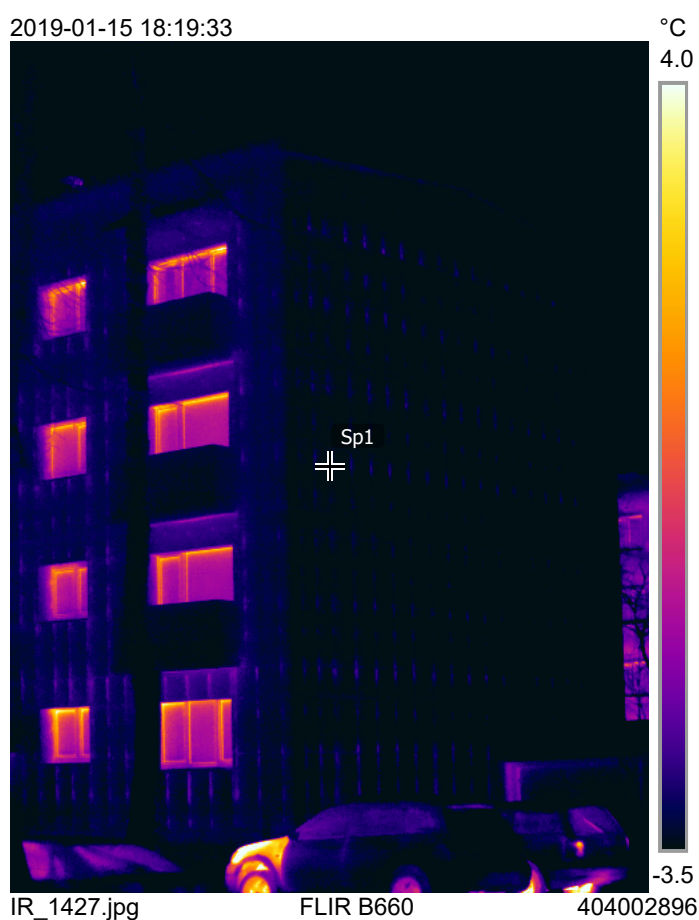

Measurements

Sp1	-3.2 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:19:52



IR_1429.jpg

FLIR B660

404002896

Measurements

Sp1	-3.1 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations

2019-01-15 18:20:08



IR_1431.jpg

FLIR B660

404002896

Measurements

Sp1	-3.2 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2 °C

Text annotations