

2019-01-22 09:27:12



Measurements


Sp1	26.6 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations

2019-01-22 09:27:36

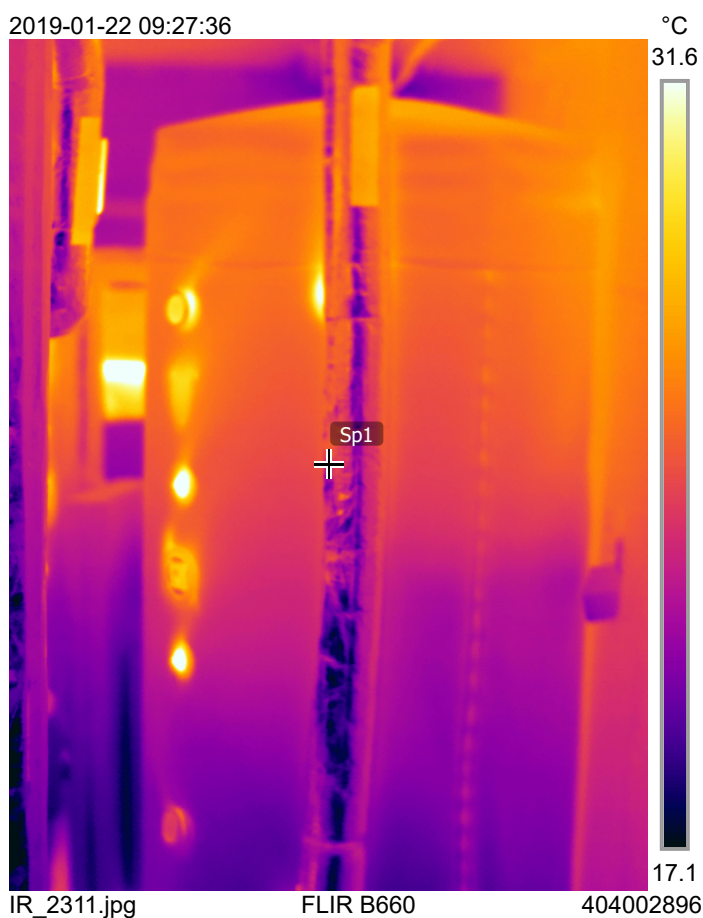

Measurements


Sp1	23.1 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations

2019-01-22 09:28:08

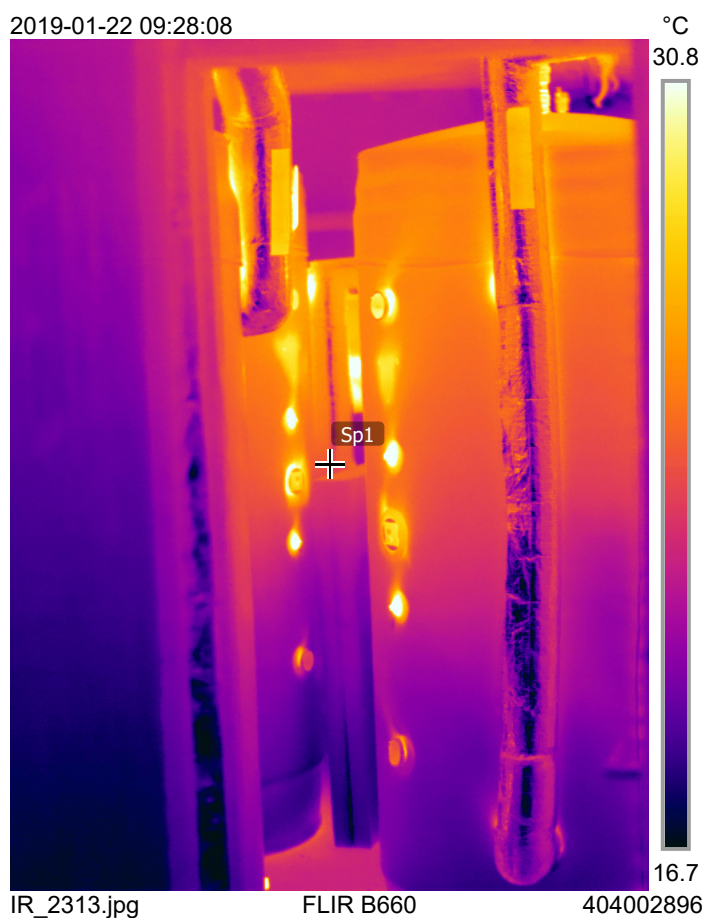

Measurements


Sp1	23.8 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations

2019-01-22 09:28:53

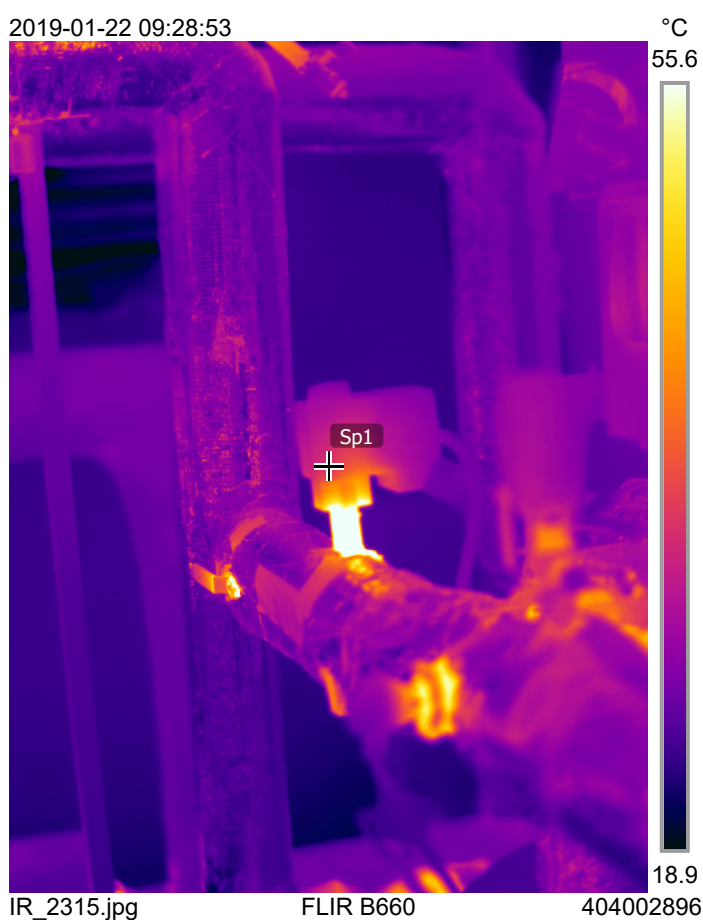

IR_2315.jpg

FLIR B660

404002896

Measurements


Sp1	36.3 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations

2019-01-22 09:29:44

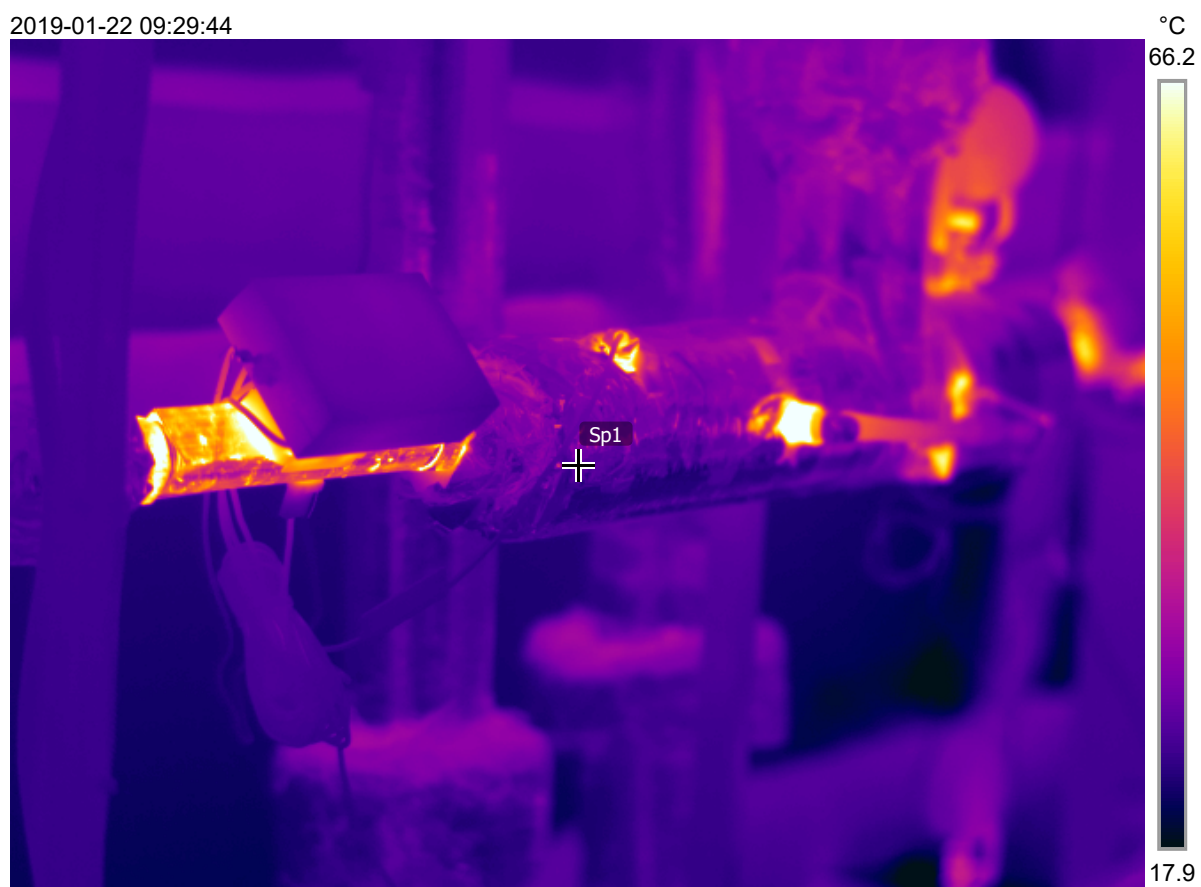

IR_2317.jpg

FLIR B660

404002896

Measurements


Sp1	27.7 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations

2019-01-22 09:30:20

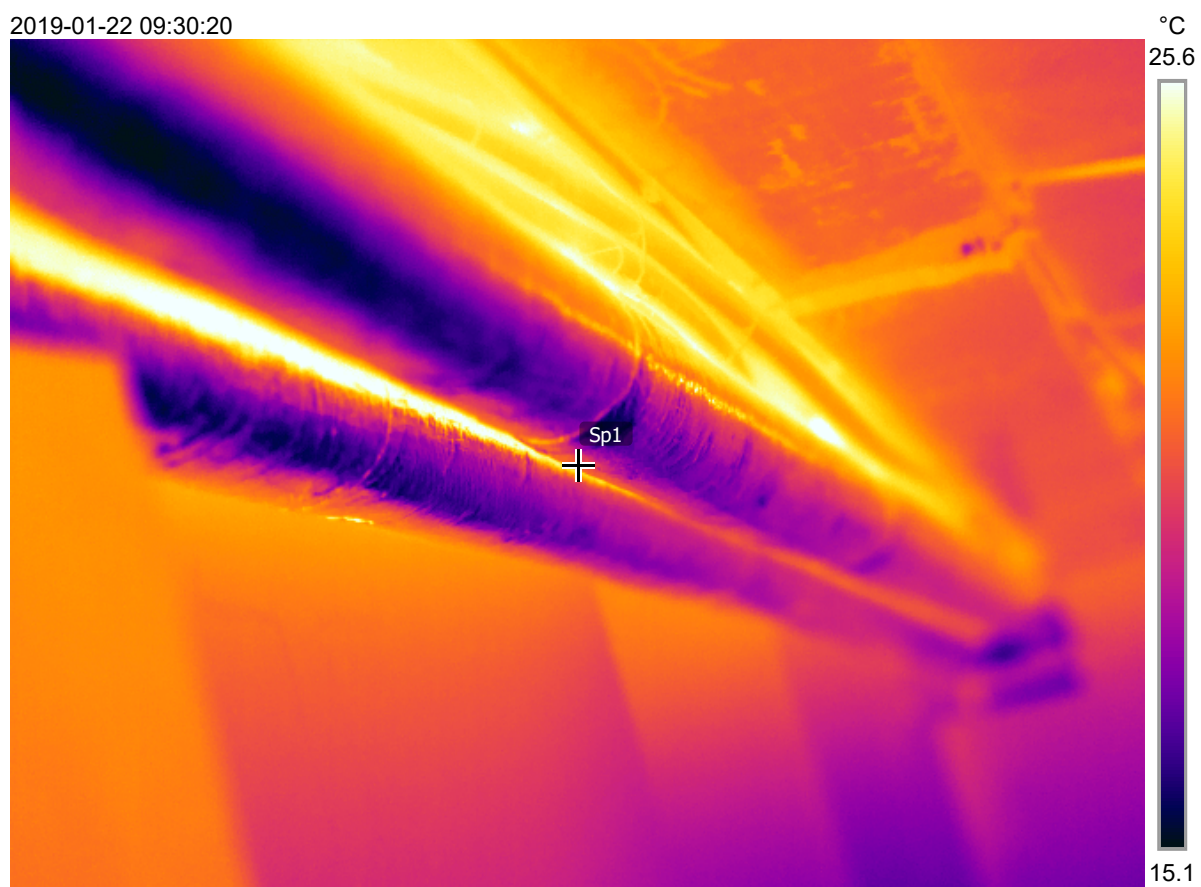

IR_2319.jpg

FLIR B660

404002896

Measurements


Sp1	21.0 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations

2019-01-22 09:31:13

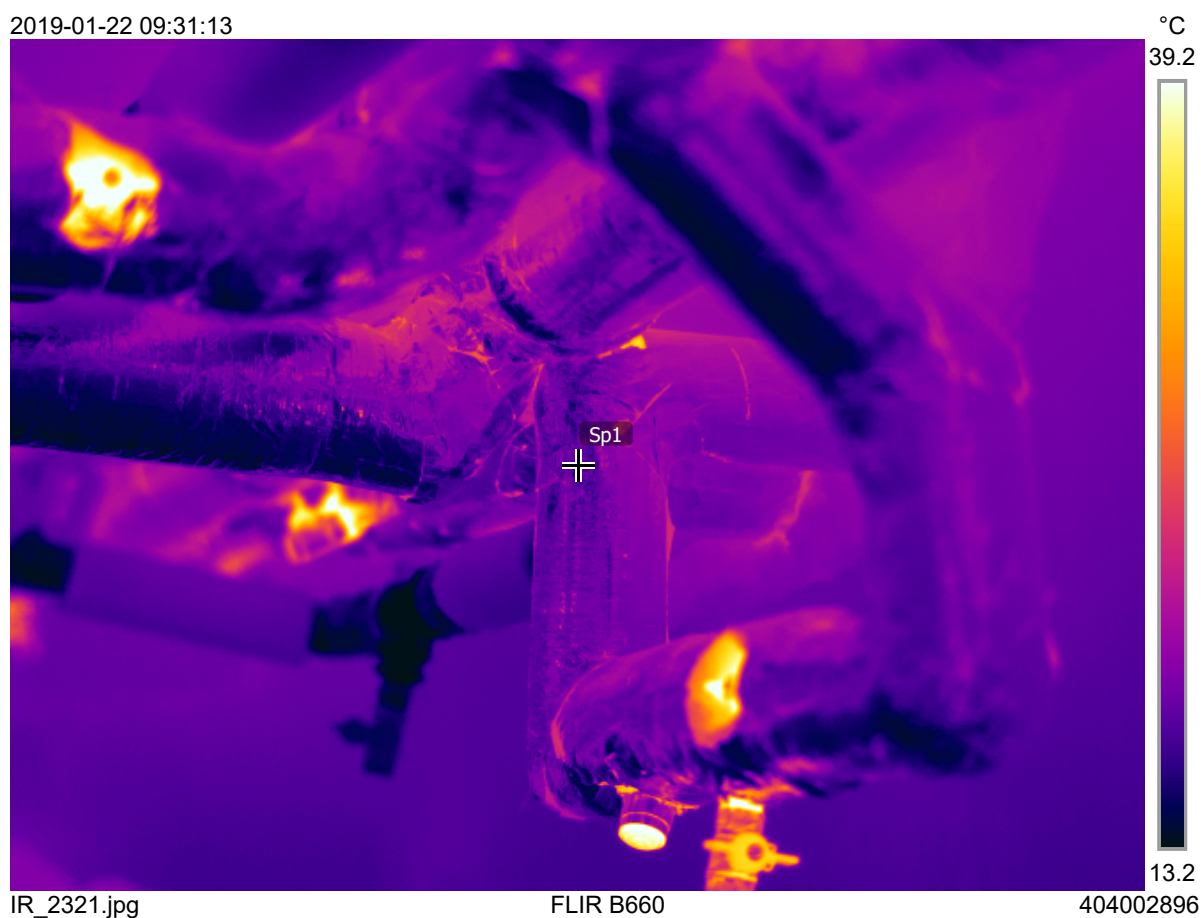

Measurements

Sp1	17.0 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations

2019-01-22 09:31:54



IR_2323.jpg

FLIR B660

404002896

Measurements


Sp1	18.9 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations

2019-01-22 09:35:01

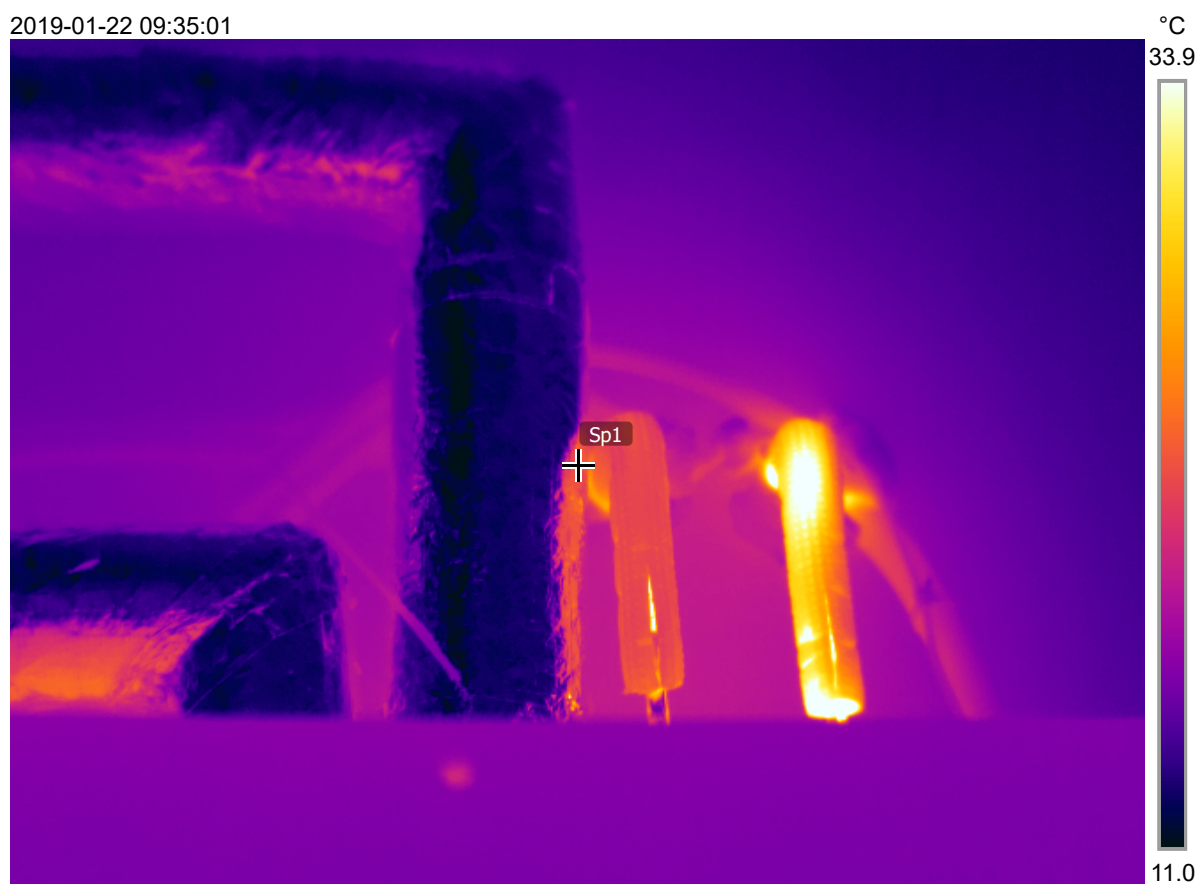

IR_2325.jpg

FLIR B660

404002896

Measurements

Sp1	23.1 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	17.1 °C

Text annotations