


2019-01-15 19:02:19

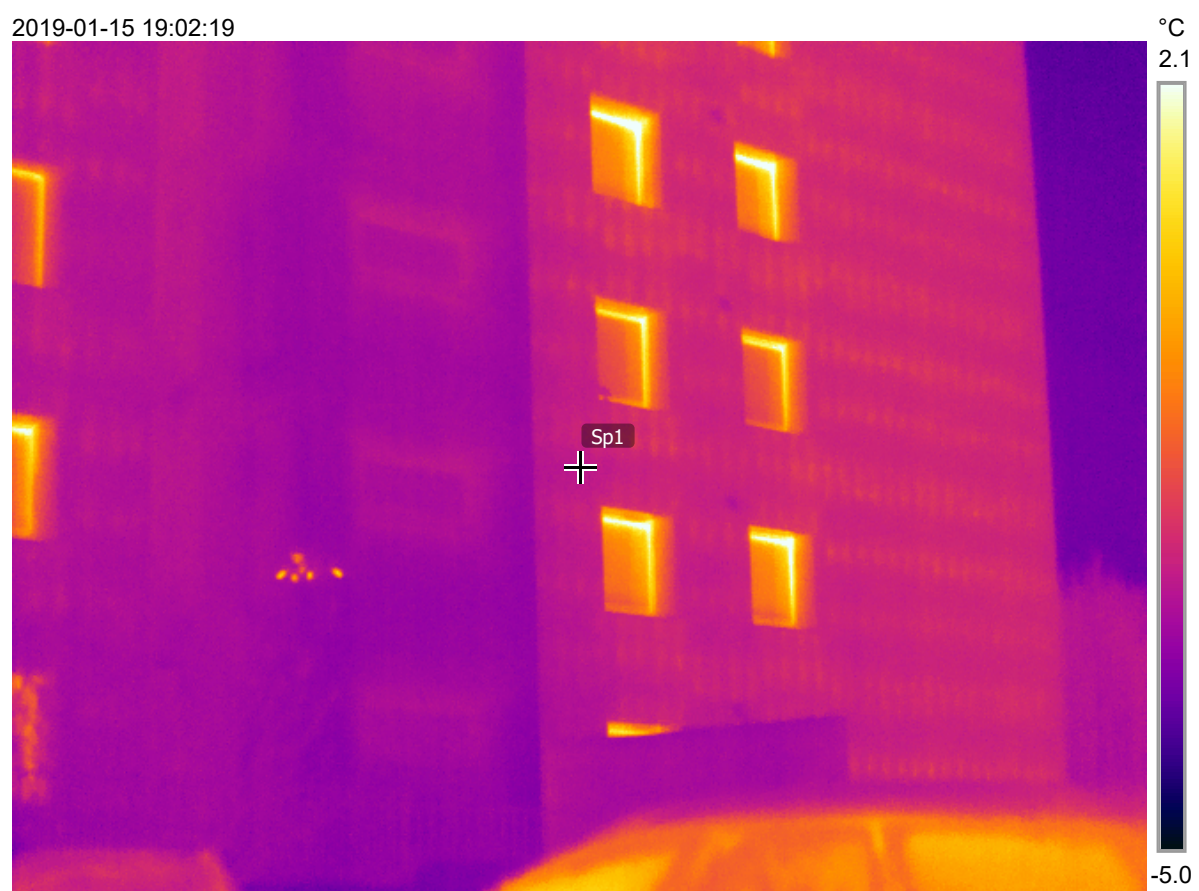

IR_1447.jpg

FLIR B660

404002896

Measurements

Sp1	-2.4 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:04:01



IR_1449.jpg

FLIR B660

404002896

Measurements

Sp1	-3.0 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:04:34



IR_1451.jpg

FLIR B660

404002896

Measurements

Sp1	-2.9 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:04:55



IR_1453.jpg

FLIR B660

404002896

Measurements


Sp1	-2.4 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:05:19

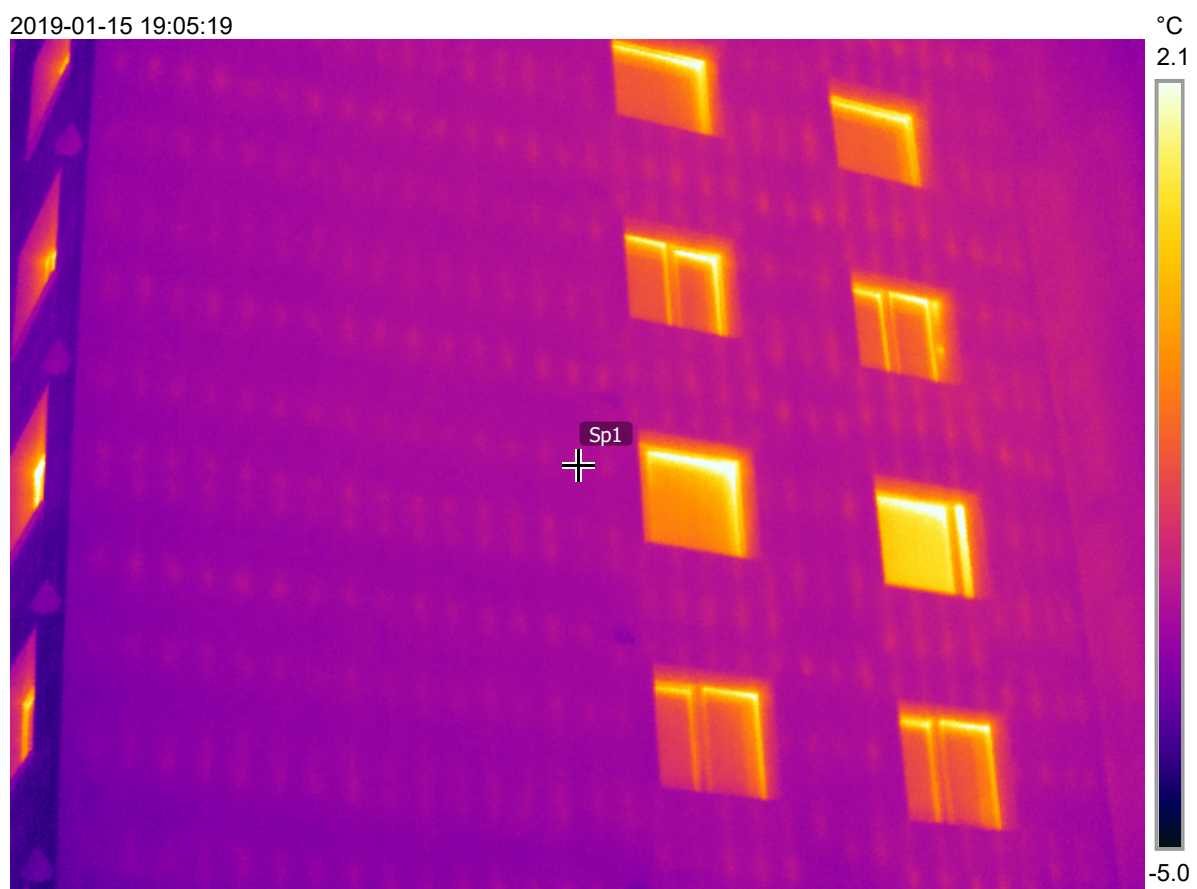

IR_1455.jpg

FLIR B660

404002896

Measurements

Sp1	-2.6 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:05:36



IR_1457.jpg

FLIR B660

404002896

Measurements


Sp1	-2.3 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:07:45

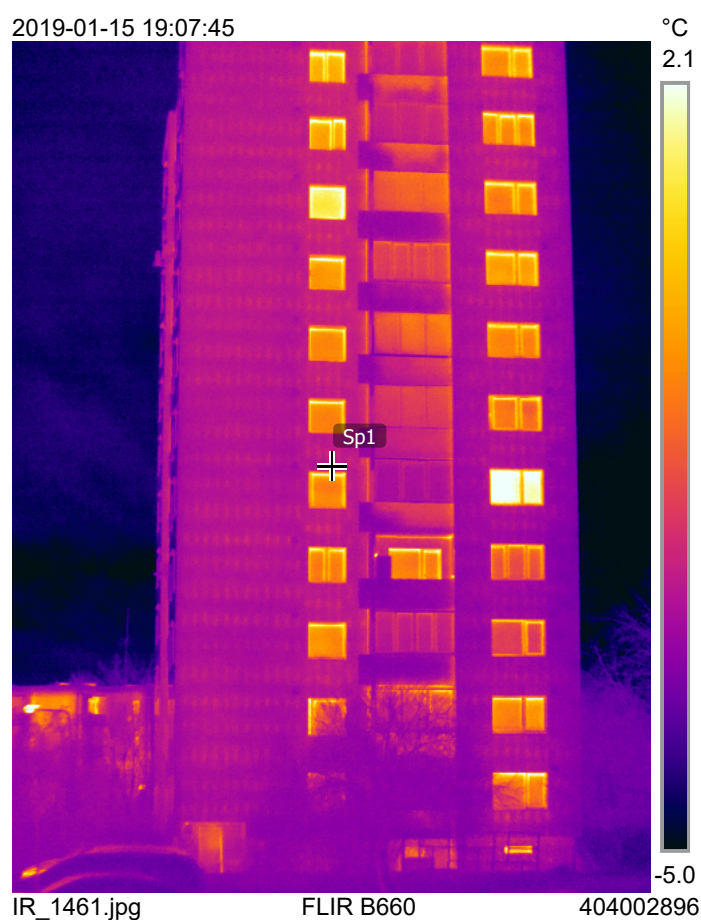

Measurements


Sp1	-2.5 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:08:02

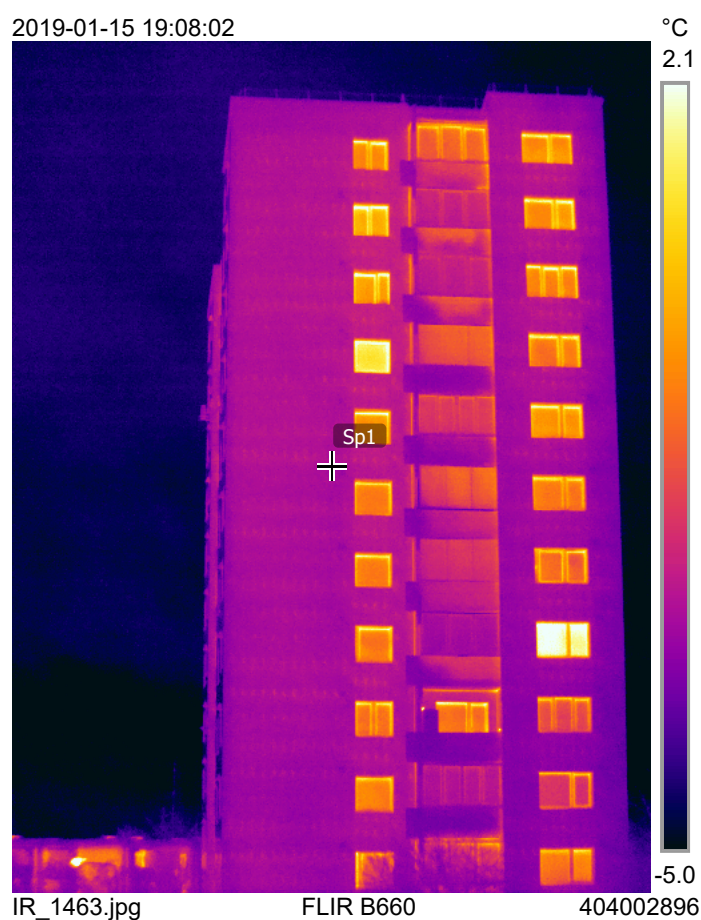

IR_1463.jpg

FLIR B660

404002896

Measurements

Sp1	-2.9 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:08:44



IR_1465.jpg

FLIR B660

404002896

Measurements


Sp1	-2.6 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:13:35

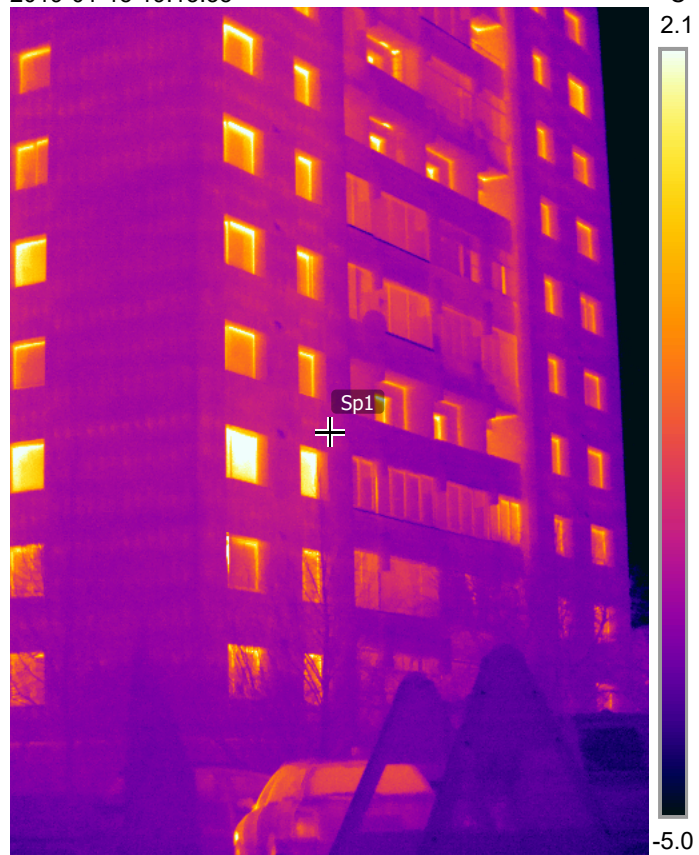

IR_1477.jpg

FLIR B660

404002896

Measurements


Sp1	-2.5 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:13:09

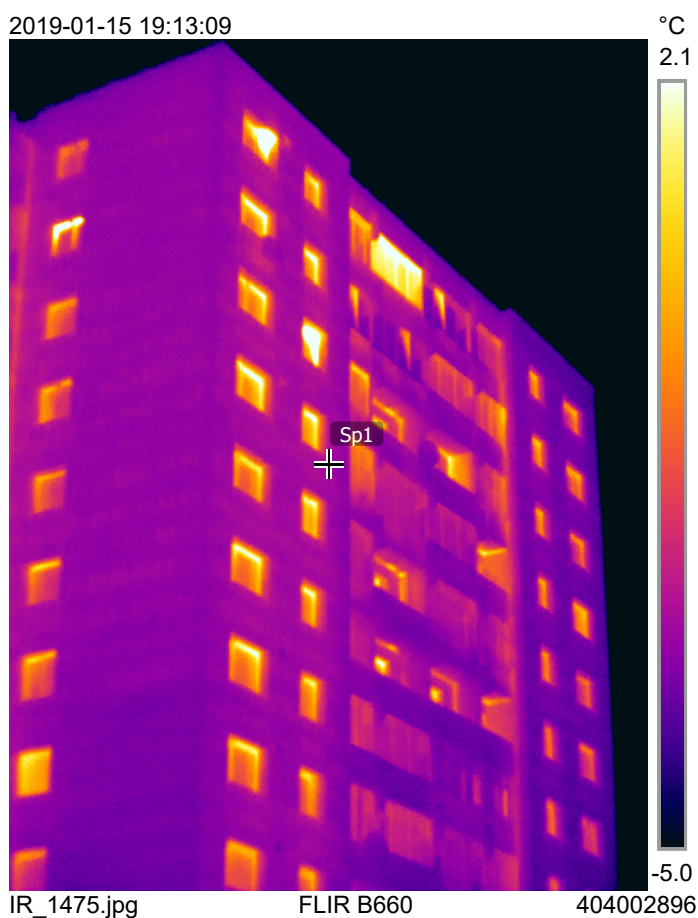

IR_1475.jpg

FLIR B660

404002896

Measurements


Sp1	-2.9 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:12:44

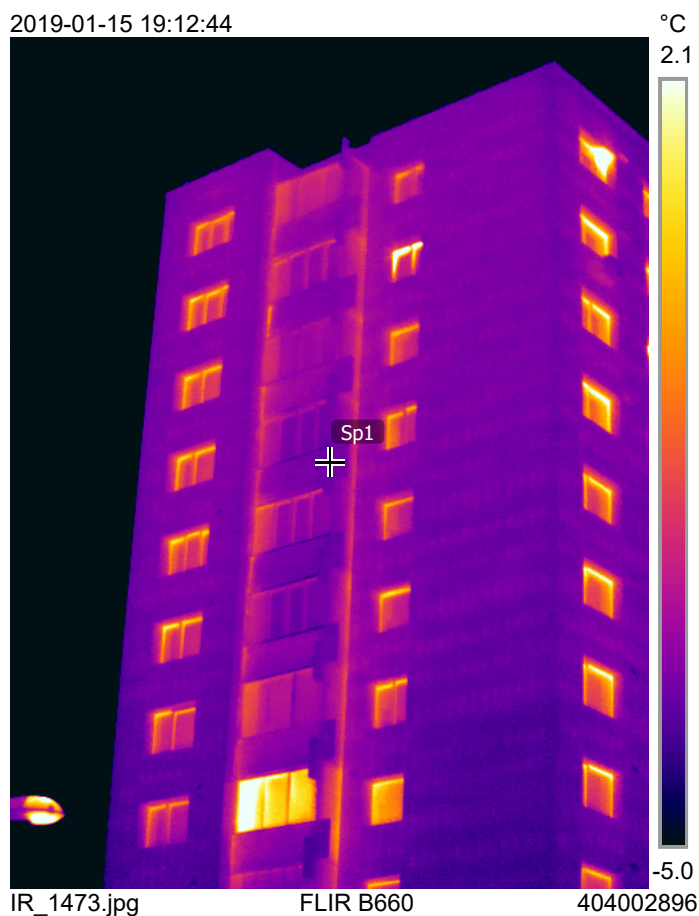

Measurements

Sp1	-3.6 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:12:28



IR_1471.jpg

FLIR B660

404002896

Measurements


Sp1	-2.8 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:10:25

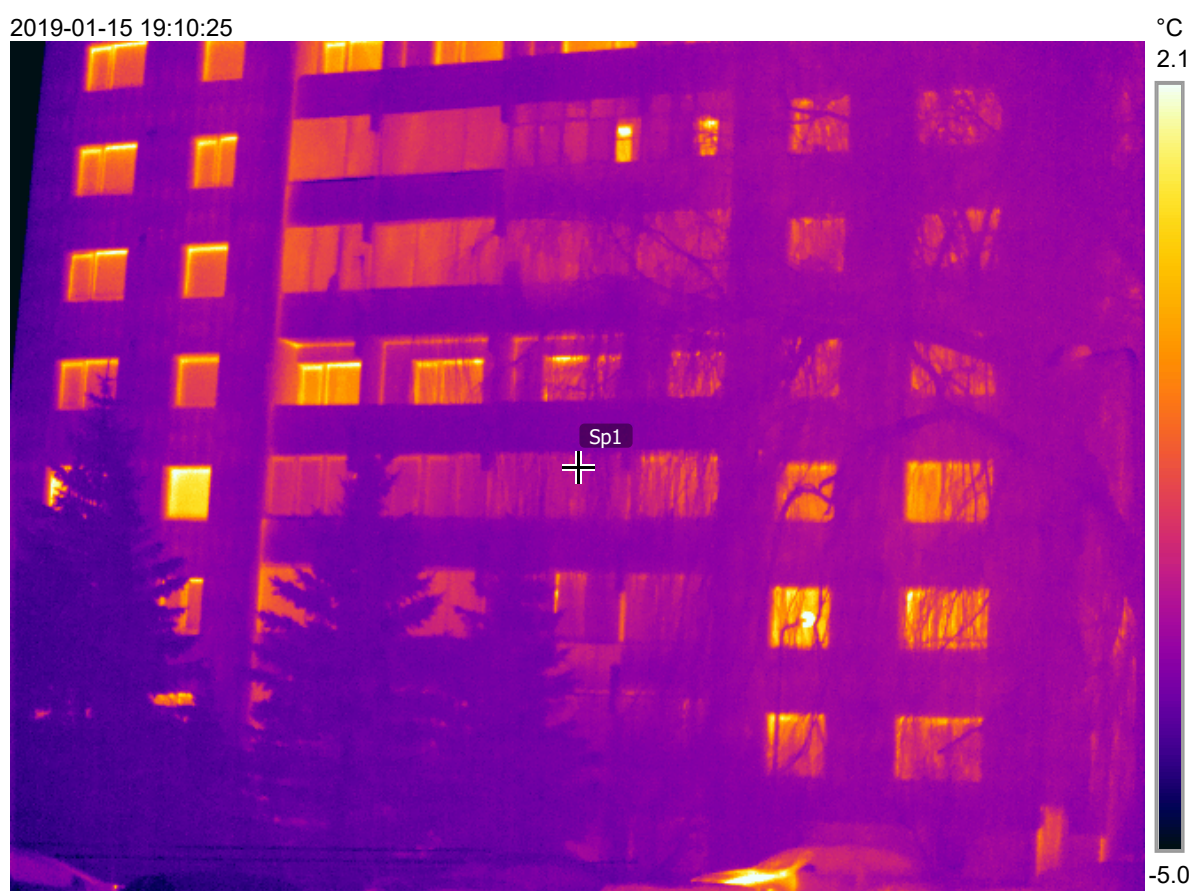

IR_1469.jpg

FLIR B660

404002896

Measurements

Sp1	-2.6 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations

2019-01-15 19:10:06



Measurements

Sp1	-2.6 °C
-----	---------

Parameters

Emissivity	0.95
Refl. temp.	-2.9 °C

Text annotations